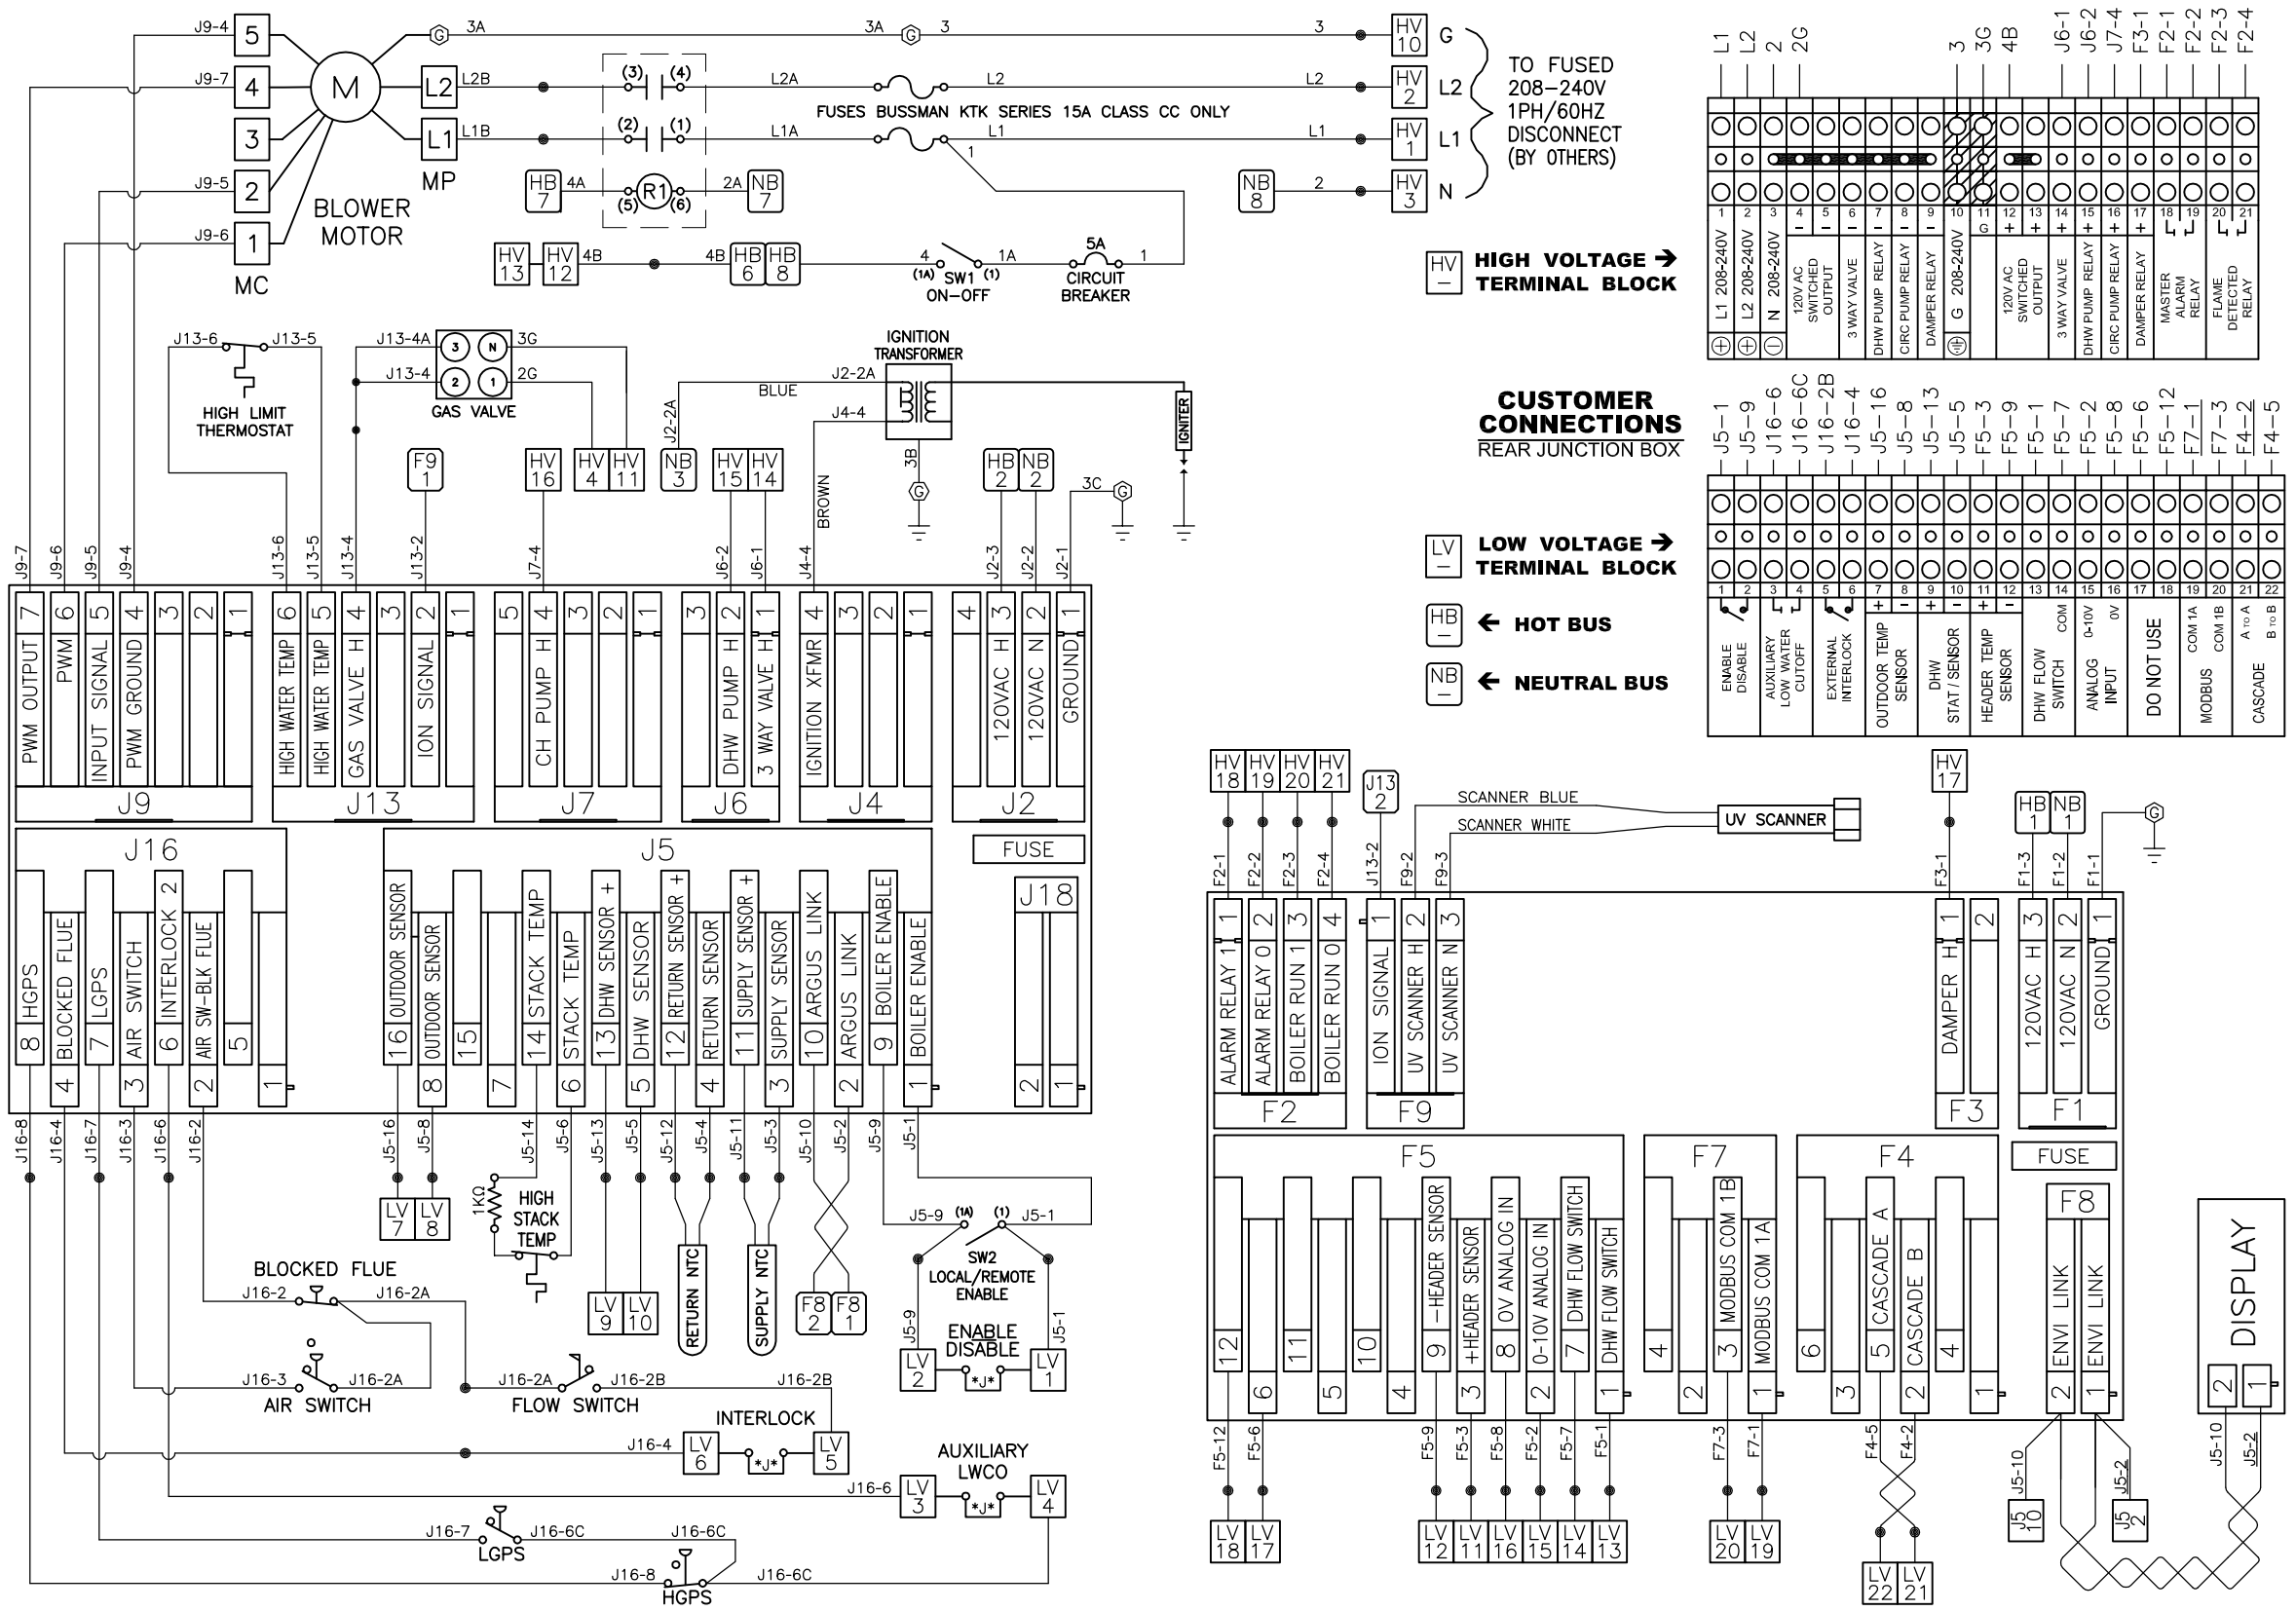

IF ANY OF THE ORIGINAL WIRE SUPPLIED WITH THIS BOILER MUST BE REPLACED, IT MUST BE REPLACED WITH THE SAME UL WIRE TYPE.

Patterson-Kelley
HARSCO
East Stroudsburg, PA 18301
570-476-7261
www.pkboilers.com

P-K MODU-FIRE® FD 2500-3000 ENVI™ Control

2300000508
REV. 0.4

REV.	DESCRIPTION	BY	CK'D.	DATE
0.2	WIRE 3A WENT TO PLUG TERMINAL 3, CHANGE TO BLOWER MOUNTING SCREW	JS	JS	05-01-09
0.1	REVISED INTERLOCK WIRING CIRCUITS J16, ECN 1627	JS	JS	04-23-09
0.4	REMOVED PUMP OUTPUT FROM LV TERMINAL LABEL CHANGED TO "DO NOT USE"	JS	JS	07-30-09
0.3	REVISED INTERLOCK WIRING CIRCUITS J16, ECN 1652	JS	JS	06-17-09

ASME CODE YES	ASME CODE NO	DESIGN PRESS.	TYPE X-RAY NONE	TYPE X-RAY SPOT	TYPE X-RAY FULL	APPROX. WEIGHT LBS.
	X	N/C	X			N/A

TITLE	WRG_DIAG,FD_MODU,2500-3000,ENVI		
		BY	DATE
DRAWN		JS	03-10-09
CHECKED			
APPROVED			

THIS DRAWING, INFORMATION AND THE SUBJECT MATTER THEREOF, ARE THE SOLE AND EXCLUSIVE PROPERTY OF PATTERSON-KELLEY CO, HARSCO CORPORATION, EAST STROUDSBURG, PA. IT MAY BE REPRODUCED BY THE PURCHASER OF THIS EQUIPMENT FOR THEIR INTERNAL USE ONLY. IT CANNOT BE DISTRIBUTED TO ANY OTHER FIRM OR PARTY WITHOUT WRITTEN CONSENT FROM OUR COMPANY.

Patterson-Kelley
Harsco
East Stroudsburg, PA 18301
570-421-7500
www.pkboilers.com

FILE SIZE	REFERENCE NO.	
D	PRINT NO.	2300000508
	REV.	0.4